



OIL-WET INCLINING PLATFORM SLIP RESISTANCE TEST

Ultimo Vinyl Flooring

Prepared for: Preference Floors
 Steven Keats
 27-29 Zilla Court
 DANDENONG SOUTH VIC 3175

Specimen Description: Ultimo Vinyl Flooring, 228x902 mm.

No. of Specimens: 1 off

Surface Structure: Smooth

Specimen Preparation: Washed with water and pH neutral detergent, rinsed then dried.

Specimen Configuration: Fixed

Test Direction: Test conducted parallel with surface profile.

Joint Type & Width: N/A

Air Temperature: 22°C

Test Standard: AS 4586:2013 Slip resistance classification of new pedestrian surface materials, Appendix D - Oil Wet Inclining Platform Test

Test Shoe: Leipzig V73-SP

Test Location: ATTAR 44-48 Rocco Drive, Scoresby, VIC, 3179

Test Date: 8 July 2021

Test Personnel: Marcus Braché and Awel Guled

Displacement Space (rounded to the nearest 0.5cm ³ /dm ²):	Not tested
Displacement Space Assessment Group (Appendix E, AS 4586 - 2013):	Not tested
Corrected mean overall acceptance angle (α_{ave}) (rounded down to the nearest degree):	12°
Classification:	R10

These results apply only to the specimens tested and it is recommended that before selection of flooring or paving materials the effect of service conditions, including maintenance procedures and wear on their slip resistance be checked.

Reviewed By:



Awel Guled
 Compliance and Test Technician
 Approved Signatory



Dale Siegle
 Compliance and Test Technician
 Approved Signatory

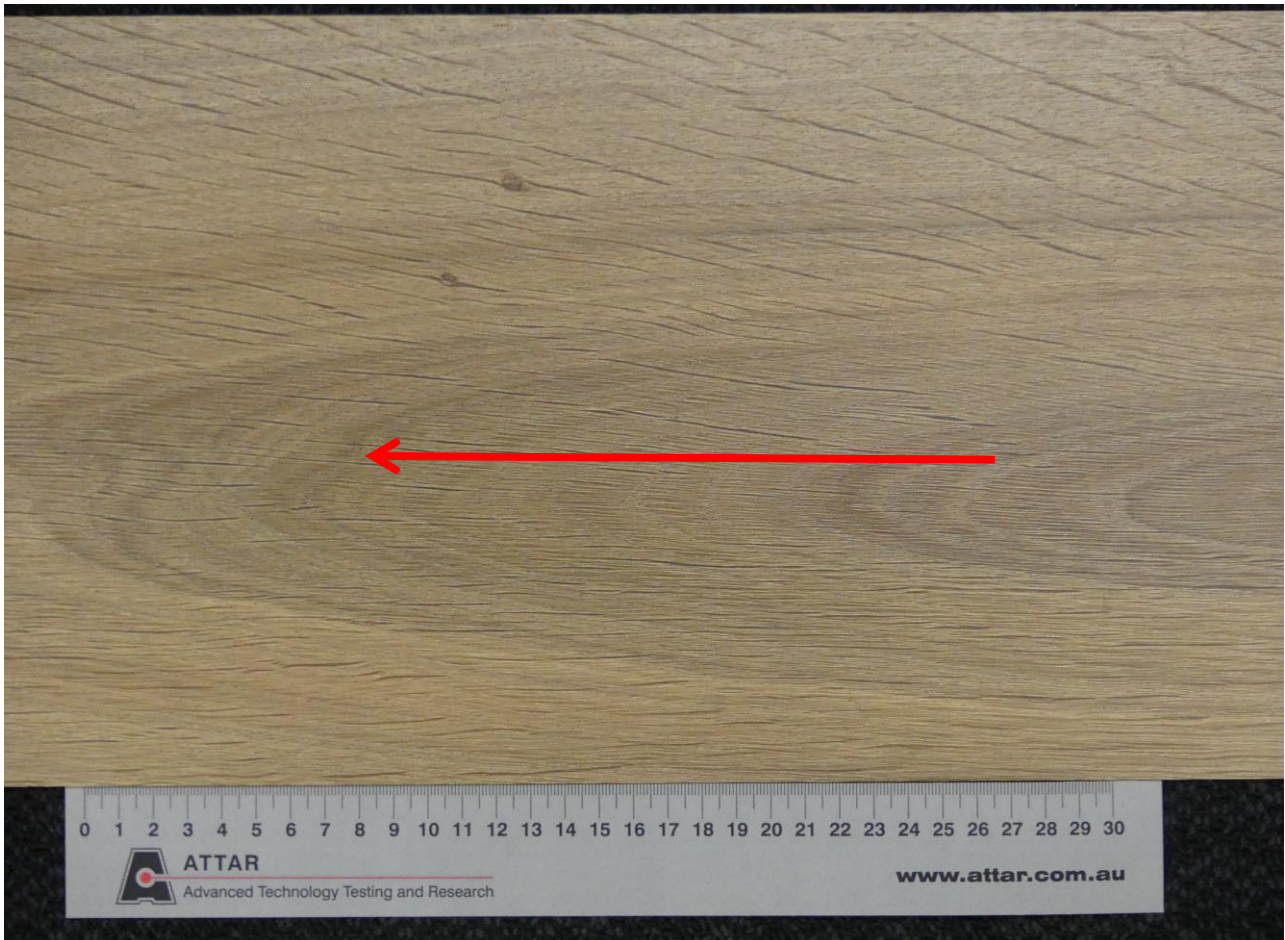


Figure 1: Ultimo Vinyl Flooring
Arrow indicates direction of testing



CLASSIFICATION CRITERIA – AS 4586 - 2013
Oil Wet Inclining Platform Test – Appendix D

Compliance

TABLE 5: CLASSIFICATION OF PEDESTRIAN SURFACE MATERIALS ACCORDING TO THE OIL-WET INCLINING PLATFORM TEST

Classification	Angle, degrees
No Classification	<6
R9	≥6 <10
R10	≥10 <19
R11	≥19 <27
R12	≥27 <35
R13	≥35